

PRELIMINARY AIR MONITORING SUMMARY

Jenkintown, PA SPS Technologies Fire March 31 – April 1, 2025

Submitted April 2, 2025

1.0 INTRODUCTION

On February 19, 2025, CTEH was contacted to provide community air monitoring for SPS Technologies, LLC in conjunction with the United States Environmental Protection Agency (USEPA) and the Pennsylvania Department of Environmental Protection (PA DEP). CTEH initially established seven stationary real-time air monitoring locations in a perimeter around the SPS Technologies facility and adjacent residential areas on the morning of February 20, 2025. Real-time air monitoring performed by CTEH began at 1208 EST on February 20, 2025. At 1000 EST on February 22, 2025, CTEH established a Kestrel 6000 cellular weather station approximately 500 feet north of the facility. On the evening of February 22, 2025, CTEH established four additional stationary monitoring locations in community areas around the facility. Consistent with the updated Air Sampling and Analysis Plan (SAP) submitted on February 23, 2025, CTEH established two additional community stationary monitoring locations on both February 23 and February 24, 2025, bringing the total number of stationary monitoring locations to fifteen. The SAP was further updated on February 26, 2025 to reflect the removal of particulate matter monitors during rain events and a change in how monitoring stations were identified. These stationary real-time monitoring locations were established to encompass a 360° monitoring perimeter around the facility and within nearby communities.

This report summarizes real-time air monitoring data collected by CTEH personnel from approximately 0600 EDT on March 31, 2025 to approximately 0600 EDT on April 1, 2025.

2.0 AIR MONITORING METHODS

Real-time air monitoring refers to the use of direct-reading instruments to provide a near-instantaneous readout of chemical concentrations in the air. On February 19, 2025, CTEH personnel developed a SAP to document and quantify the potential release of fugitive emissions from the incident. CTEH has continued to update the SAP and associated monitoring locations based on feedback from PA DEP. The analytes chosen for air monitoring were coordinated with representatives from USEPA and PA DEP for this incident based on the Tier II documentation for the SPS Technologies Facility.

Handheld real-time air monitoring refers to data collected by roaming CTEH personnel using handheld air monitoring instruments. Stationary real-time air monitoring refers to stationary instruments that record air monitoring data approximately every 15 seconds and send the data in real time to a centralized location via radio telemetry. Handheld and Stationary real-time air monitoring were conducted using RAE® Systems by Honeywell MultiRAE Pro and AreaRAE instruments equipped with 10.6 eV photoionization detectors and multiple electrochemical sensors, ChemLogic CLPx portable gas detectors, and Gastec GV-100 pumps equipped with chemical-specific, colorimetric detector tubes. These analytes include volatile organic compounds (VOCs), hydrogen cyanide (HCN), hydrogen sulfide (H₂S), chlorine (Cl₂),



carbon monoxide (CO), sulfuric acid, nitric acid, and flammability as a percentage of the lower explosive limit (%LEL). Additionally, handheld and stationary real-time air monitoring for particulate matter of 2.5 μ m diameter or less (PM_{2.5}) was conducted using TSI SidePak AM520 instruments.

Stationary air monitoring equipment is subject to drift events, which are defined as any interference in an instrument's photoionization detector (PID; 10.6 eV) or electrochemical sensor's ability to accurately report the concentration of a chemical in the atmosphere. Common sources of drift include impacts from humidity, temperature changes, and issues with instrument batteries. These drift sources may cause air monitoring equipment to report consistent, low-level detections in the absence of chemicals present in the air.

In total, CTEH has established fifteen stationary real-time air monitoring locations as part of this response. Six air monitoring stations were installed around the perimeter of the impacted facility. The remaining nine monitoring stations were established in the communities surrounding the impacted facility, including schools and parks. These locations include Baederwood Park, the Glenside Youth Athletic Club Baseball Fields, the Noble Train Station, Jenkintown Middle/High School, Salus University, Thomas Williams Park, Curtis Arboretum, Arcadia University, and Glenn Memorial Hall.

3.0 AIR MONITORING RESULTS

Maps of the incident location, real-time air monitoring results, and the locations of stationary real-time air monitoring locations are provided in **Attachment A**. The results of handheld real-time air monitoring are summarized in **Table 1**. The results of stationary real-time air monitoring from the perimeter locations are summarized in **Tables 2 and 3**. The results of the stationary real-time air monitoring from the community locations are summarized in **Tables 4 and 5**. Visual depictions of the stationary real-time air monitoring data from the perimeter locations are provided in **Attachment B**. Visual depictions of the stationary real-time air monitoring data from the community locations are provided in **Attachment C**. A wind rose depicting wind direction and wind speed during this reporting period is provided in **Attachment D**. Meteorological data were acquired from both the PHILADELPHIA NE weather station in Philadelphia, PA, and a Kestrel 6000 cellular weather station located approximately 500 feet north of the facility.



3.1 Handheld Real-Time Air Monitoring Results

Table 1: Handheld Real-Time Perimeter and Expanded Community Air Monitoring Results †

Analyte	Instrument	Number of Readings	Number of Detections	Concentration Range*
Cl ₂	CLPx Cassette 1-560-070	84	0	< 44 ppb
	MultiRAE	68	0	< 0.1 ppm
H ₂ S	MultiRAE	15	0	< 0.1 ppm
Nitric Acid	Gastec #15L	172	0	< 0.05 ppm
Sulfuric Acid	CLPx Cassette 1-410-070	22	0	< 23.3 ppb
	Gastec #35	163	0	< 0.2 mg/m³

[†]Note: This is a preliminary data summary, indicating that the data provided has not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time.

There were no detections of any analyte evaluated during Handheld Perimeter Air Monitoring or Handheld Community Air Monitoring in this reporting period.

3.2 Stationary Real-Time Perimeter Air Monitoring Results

Table 2. Summary of Stationary Real-Time Perimeter Air Monitoring AreaRAE Results[†]

Unit	Analyte	Number of Readings	Number of Detections	Concentration Range*
	CO	5,596	3	2.0 - 5.0 ppm
	H ₂ S	5,596	0	< 0.1 ppm
Station 01	HCN	5,596	0	< 1.0 ppm
	%LEL	5,596	0	< 1.0 %
	VOCs	5,596	690	0.1 - 0.2 ppm
	CO	5,620	0	< 1.0 ppm
	H ₂ S	5,620	0	< 0.1 ppm
Station 03	HCN	5,620	0	< 1.0 ppm
	%LEL	5,620	0	< 1.0 %
	VOCs	5,620	0	< 0.1 ppm
	CO	5,528	3	3.0 - 4.0 ppm
	H ₂ S	5,528	0	< 0.1 ppm
Station 04	HCN	5,366	0	< 1.0 ppm
	%LEL	5,528	0	< 1.0 %
	VOCs	5,350	1,046	0.1 - 0.4 ppm



^{*}If no detectable concentration was observed, the instrument detection limit is preceded by a "<" symbol.

	CO	5,629	0	< 1.0 ppm
_		·		
	H_2S	5,629	0	< 0.1 ppm
Station 05	HCN	5,629	0	< 1.0 ppm
	%LEL	5,629	0	< 1.0 %
	VOCs	5,629	242	0.1 ppm
	CO	5,608	0	< 1.0 ppm
_	H ₂ S	5,608	0	< 0.1 ppm
Station 06	HCN	5,608	0	< 1.0 ppm
_	%LEL	5,608	0	< 1.0 %
	VOCs	5,608	315	0.1 ppm
	CO	5,631	59	2.0 - 33.0 ppm
	H ₂ S	5,631	0	< 0.1 ppm
Station 07	HCN	5,631	0	< 1.0 ppm
_	%LEL	5,631	0	< 1.0 %
_	VOCs	5,564	1,612	0.1 - 0.5 ppm

[†]Note: This is a preliminary data summary, indicating that the data provided has not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time. AreaRAE monitoring data contains drift events. Drift is defined as any interference in an instrument's photoionization detector (PID; 10.6 eV) or electrochemical sensor's ability to accurately report the concentration of a chemical in the atmosphere. Humidity, rapid temperature changes, and compromised instrument batteries are examples of common sources of drift.

* If no detection was observed, the instrument detection limit preceded by a "<" symbol is listed; ppm = parts per million

Table 3: Summary of Stationary Real-Time Perimeter Air Monitoring PM_{2.5} Results[†]

Unit	Instrument	24-Hour PM _{2.5} NAAQS	Average PM _{2.5} Concentration (mg/m ³)
Station 1	AM520	0.035	0.011
Station 3	AM520	0.035	0.009
Station 4	AM520	0.035	0.009
Station 5	AM520	0.035	0.010
Station 6	AM520	0.035	0.010
Station 7	AM520	0.035	0.010

[†]Note: This is a preliminary data summary, indicating that the data provided has not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time.

During stationary real-time perimeter air monitoring, there were no detections of H_2S , HCN, or %LEL at any air monitoring station. Transient, low-level detections of CO were observed at Stations 1, 4, and 7. These detections may be attributed to heavy equipment and vehicles operating at the impacted facility. During this reporting period, $PM_{2.5}$ monitoring was paused at approximately 0630 EDT and resumed at approximately 0945 EDT on March 31 due to a rain event per the SAP v1.2 addendum. Later that evening, $PM_{2.5}$ was again paused at approximately 1530 EDT on March 31 due to another rain event per the SAP



v1.2 addendum. There were no elevated average $PM_{2.5}$ concentrations observed in the perimeter monitoring locations during this reporting period.

3.3 Stationary Real-Time Expanded Community Air Monitoring Results

Table 4. Summary of Stationary Real-Time Expanded Community Air Monitoring AreaRAE Results[†]

Unit	Analyte	Count of Readings	Count of Detections	Range of Detections
	СО	5,430	0	< 1.0 ppm
	H ₂ S	5,430	0	< 0.1 ppm
Station 02	HCN	5,430	0	< 1.0 ppm
	LEL	5,430	0	< 1.0 %
	VOCs	5,343	13	0.1 ppm
	СО	5,490	0	< 1.0 ppm
	H ₂ S	5,490	0	< 0.1 ppm
Station 08	HCN	5,490	0	< 1.0 ppm
	LEL	5,490	0	< 1.0 %
	VOCs	5,490	0	< 0.1 ppm
	СО	5,877	0	< 1.0 ppm
	H ₂ S	5,877	0	< 0.1 ppm
Station 09	HCN	5,877	0	< 1.0 ppm
	LEL	5,877	0	< 1.0 %
	VOCs	5,877	0	< 0.1 ppm
	СО	5,657	0	< 1.0 ppm
	H ₂ S	5,657	0	< 0.1 ppm
Station 10	HCN	5,657	0	< 1.0 ppm
	LEL	5,657	0	< 1.0 %
	VOCs	5,657	0	< 0.1 ppm
	СО	5,698	0	< 1.0 ppm
	H ₂ S	5,698	0	< 0.1 ppm
Station 11	HCN	5,698	0	< 1.0 ppm
	LEL	5,698	0	< 1.0 %
	VOCs	5,698	0	< 0.1 ppm
	СО	5,827	0	< 1.0 ppm
	H ₂ S	5,827	0	< 0.1 ppm
Station 12	HCN	5,827	0	< 1.0 ppm
	LEL	5,827	0	< 1.0 %
	VOCs	5,827	0	< 0.1 ppm
Ctatia : 12	СО	5,878	0	< 1.0 ppm
Station 13	H ₂ S	5,878	0	< 0.1 ppm



	HCN	5,878	0	< 1.0 ppm
	LEL	5,878	0	< 1.0 %
	VOCs	5,816	162	0.1 ppm
	CO	5,554	0	< 1.0 ppm
	H ₂ S	5,554	0	< 0.1 ppm
Station 14	HCN	5,554	0	< 1.0 ppm
	LEL	5,554	0	< 1.0 %
	VOCs	5,554	0	< 0.1 ppm
	СО	5,582	0	< 1.0 ppm
	H ₂ S	5,582	0	< 0.1 ppm
Station 15	HCN	5,582	0	< 1.0 ppm
	LEL	5,582	0	< 1.0 %
	VOCs	5,521	30	0.1 ppm

[†]Note: This is a preliminary data summary, indicating that the data provided have not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time. AreaRAE monitoring data contain drift events. Drift is defined as any interference in an instrument's photoionization detector (PID; 10.6 eV) or electrochemical sensor's ability to accurately report the concentration of a chemical in the atmosphere. Humidity, rapid temperature changes, and compromised instrument batteries are examples of common sources of drift.

Table 5: Summary of Stationary Real-Time Expanded Community Air Monitoring PM_{2.5} Results [†]

Unit	Instrument	24-Hour PM _{2.5} NAAQS	Average PM _{2.5} Concentration (mg/m ³)
Station 2	AM520	0.035	0.009
Station 8	AM520	0.035	0.010
Station 9	AM520	0.035	0.009
Station 10	AM520	0.035	0.011
Station 11	AM520	0.035	0.010
Station 12	AM520	0.035	0.011
Station 13	AM520	0.035	0.011
Station 14	AM520	0.035	0.010
Station 15	AM520	0.035	0.010

[†]Note: This is a preliminary data summary, indicating that the data provided has not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time.

Stationary real-time monitoring at nine locations in communities surrounding the facility indicated no detections of CO, H₂S, HCN, or %LEL. During this reporting period, PM_{2.5} monitoring was paused at approximately 0630 EDT and resumed at approximately 0945 EDT on March 31 due to a rain event per the SAP v1.2 addendum. Later that evening, PM_{2.5} was again paused at approximately 1530 EDT on March



^{*} If no detection was observed, the instrument detection limit preceded by a "<" symbol is listed; ppm = parts per million

31 due to another rain event per the SAP v1.2 addendum. There were no elevated average $PM_{2.5}$ concentrations observed in the community monitoring locations during this reporting period.

3.4 Analyte-Specific Action Levels

As part of the SAP, air monitoring action levels were identified for air monitoring detections for which onsite incident management members should be notified. The action levels identified in the SAP are provided in **Table 6**.

Table 6: Analyte-Specific Action Levels Resulting in Stakeholder Notification

Action Levels

Concentration Durations		Sustained for 5 Minutes	Sustained for 30 Seconds			
Analyte	CAS	Protective Action Criteria 1 (PAC-1)	½ Protective Action Criteria 2 (½ PAC-2)			
Sulfuric Acid	7664-93-9	0.05 ppm	1.1 ppm			
Nitric Acid	7697-37-2	0.16 ppm	12 ppm			
Hydrogen Cyanide	74-90-8	2 ppm	3.5 ppm			
Hydrogen Sulfide	7783-06-4	0.51 ppm	13.5 ppm			
Chlorine	7782-50-5	0.5 ppm	1.0 ppm			

If any analyte exceeds the PAC-1 for 5 minutes and is confirmed with a secondary instrument or if any analyte exceeds ½ PAC-2 for 30 seconds, the CTEH monitoring personnel will immediately contact the CTEH Project Technical Director via a telephone call. The CTEH Project Technical Director will then notify a designated group of SPS representatives via group text message and individual phone calls for appropriate stakeholder notifications and emergency management decision-making.

During this reporting period, there were no action level exceedances of any analyte evaluated requiring notification of on-site incident management.

4.0 METEOROLOGICAL CONDITIONS

Attachment D contains wind roses depicting wind speed and direction from station PHILADELPHIA NE, approximately 6.89 miles from the site, and a Kestrel 6000 cellular monitoring station located approximately 500 feet north of the facility.



Attachment A


Maps



CTEH


SPS Technologies Fire

Incident Location
Abington Township, PA | Montgomery
County
PROJ-052216

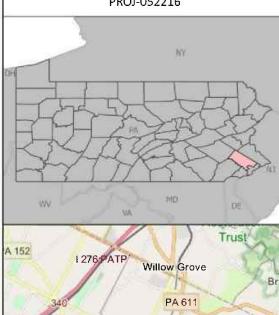




Updated At: 2/20/2025 4:59 PM
Projection: NAD 1983 2011 StatePlane Pennsylvania South
FIPS 3702

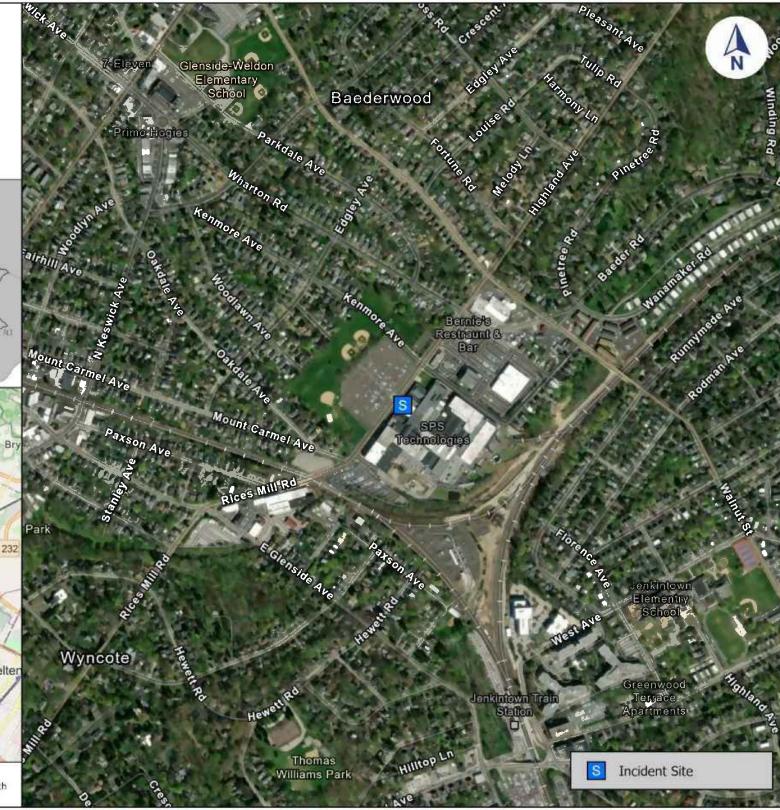



Project: PROJ-052216
City: Abington Township, PA
County: Montgomery

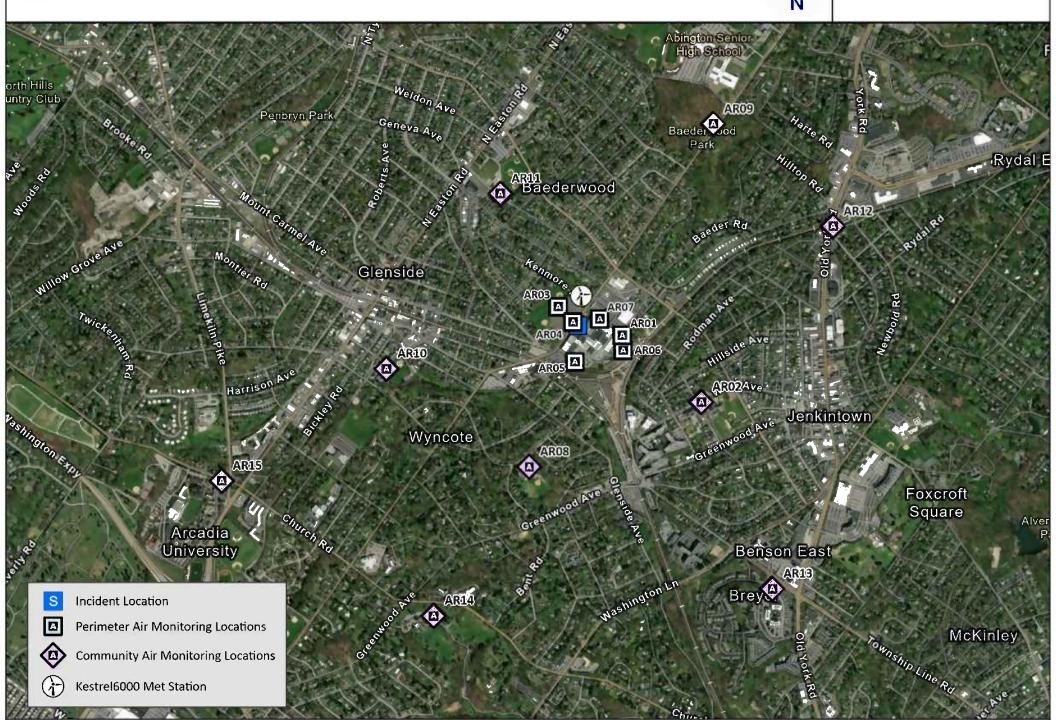

CTEH* Handheld Real-Time Air Monitoring Locations | Community Monitoring | Cl₂ SPS Technologies Fire | 03/31/2025 06:00 to 04/01/2025 06:00 EDT



Project: PROJ-052216 City: Abington Township, PA County: Montgomery

Kydai P Penbryn Park Geneva Ave Baederwood Rydal East Baederwood Glenside West Ave Jenkintown Wyncote Foxcroft Square Alverthorpe Arcadia . Park University Benson East Cheltenham Township Adult Brey Incident Location Cl₂ | MultiRAE Cedarbrook Hill < 0.1 ppm Cl₂ | CLPx Cassette 1-560-070 < 44 ppb

1,000

Handheld Real-Time Air Monitoring Locations | Community Monitoring | H₂S SPS Technologies Fire | 03/31/2025 06:00 to 04/01/2025 06:00 EDT


Projection: NAD 1983 2011 StatePlane Pennsylvania South FIPS 3702



Project: PROJ-052216 City: Abington Township, PA

County: Montgomery

Updated At: 4/1/2025 3:14 PM

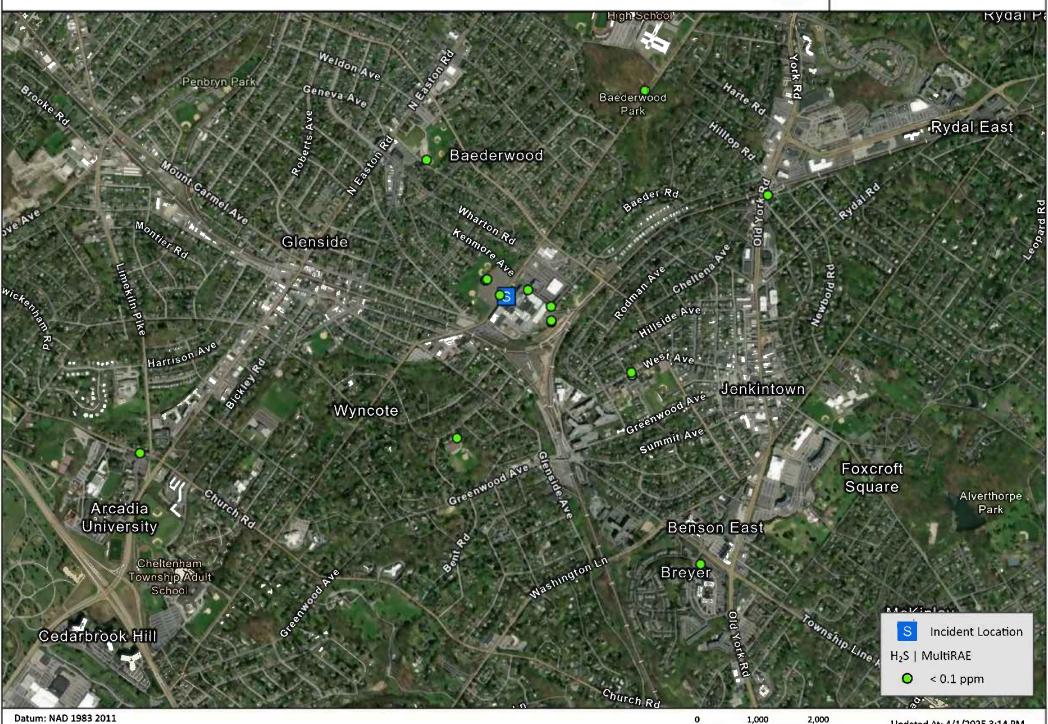

CTEH°


Handheld Real-Time Air Monitoring Locations | Community Monitoring | Nitric Acid

SPS Technologies Fire | 03/31/2025 06:00 to 04/01/2025 06:00 EDT



Project: PROJ-052216 City: Abington Township, PA

County: Montgomery

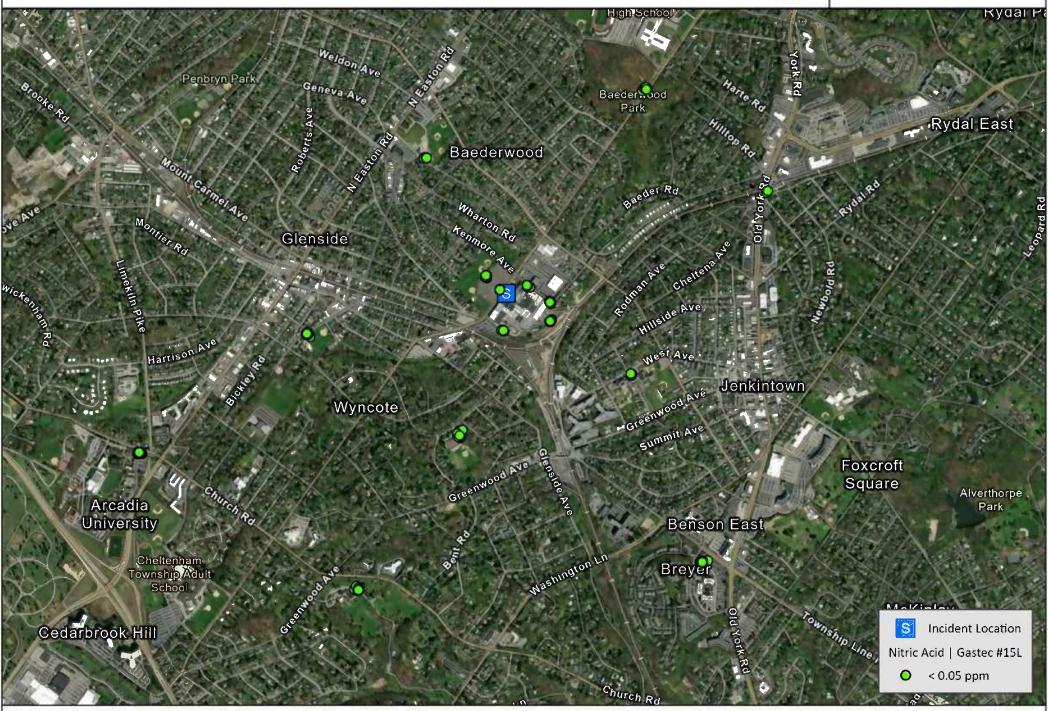

Projection: NAD 1983 2011 StatePlane Pennsylvania South FIPS 3702

Handheld Real-Time Air Monitoring Locations | Community Monitoring | Sulfuric Acid


SPS Technologies Fire | 03/31/2025 06:00 to 04/01/2025 06:00 EDT



Project: PROJ-052216 City: Abington Township, PA

Updated At: 4/1/2025 3:13 PM

County: Montgomery

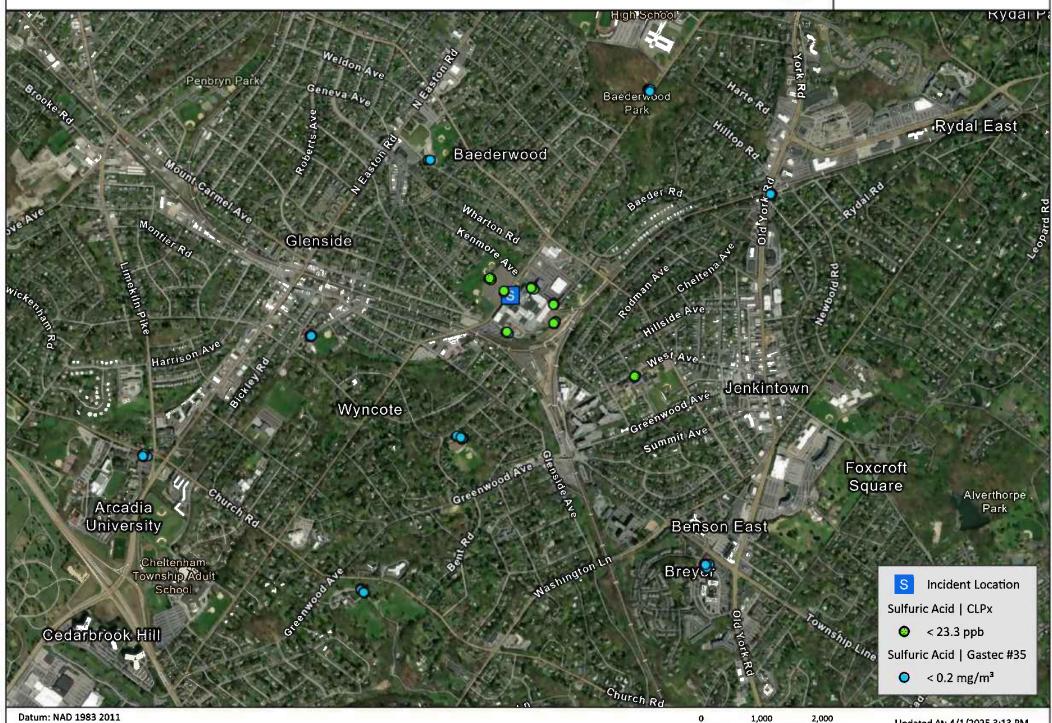


Attachment B


Stationary Real-Time Perimeter Monitoring Graphs




PROJ-052216 | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:02:06 AM to 4/1/2025 4:00:18 AM | **Analyte: CO (ppm)**

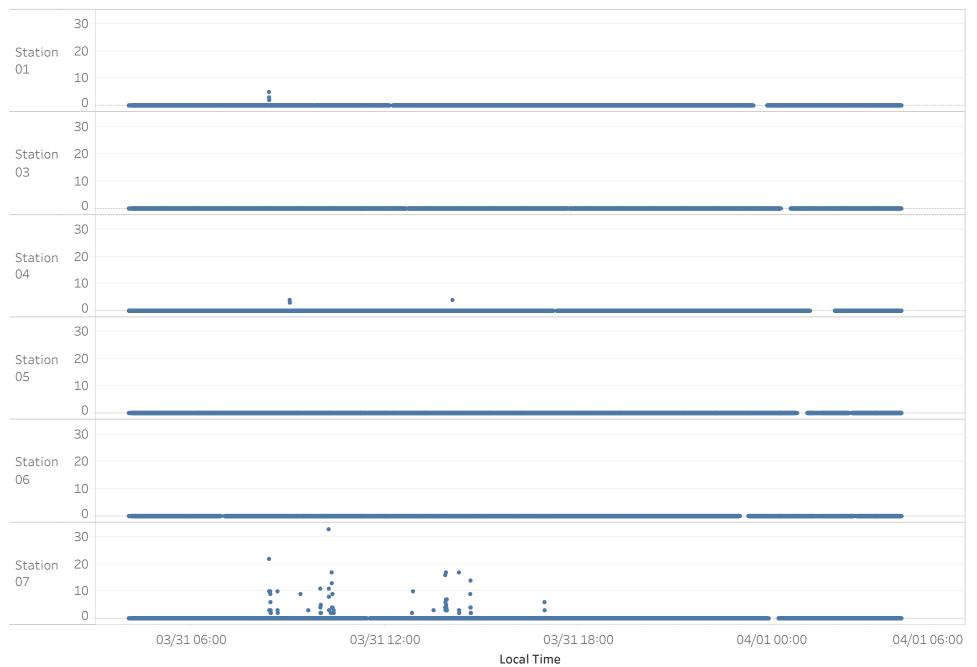


PROJ-052216 | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:02:06 AM to 4/1/2025 4:00:18 AM | **Analyte: H2S (ppm)**

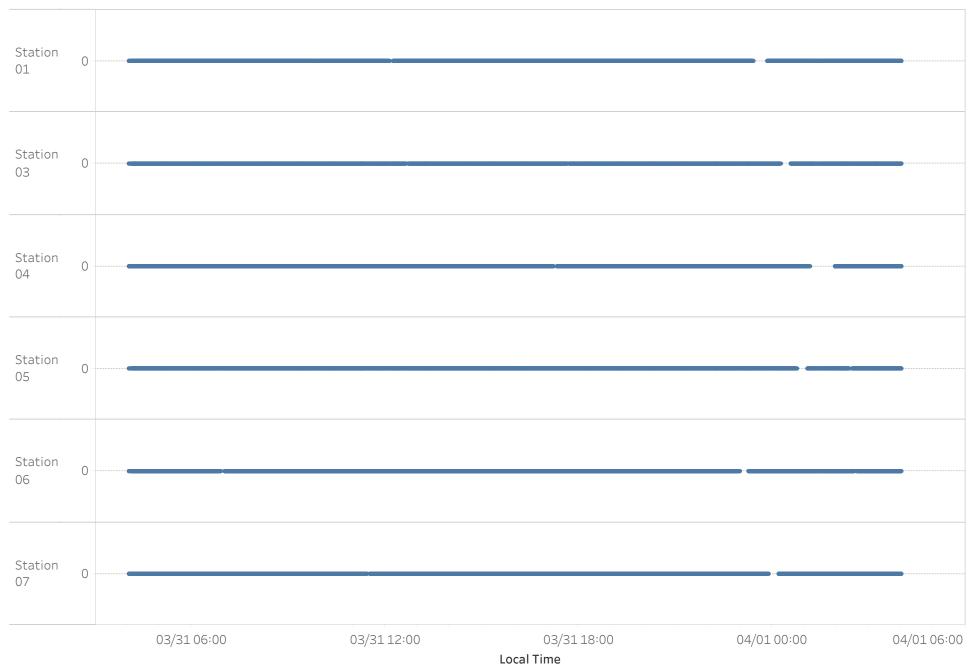


PROJ-052216 | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:02:06 AM to 4/1/2025 4:00:18 AM | **Analyte: HCN (ppm)**

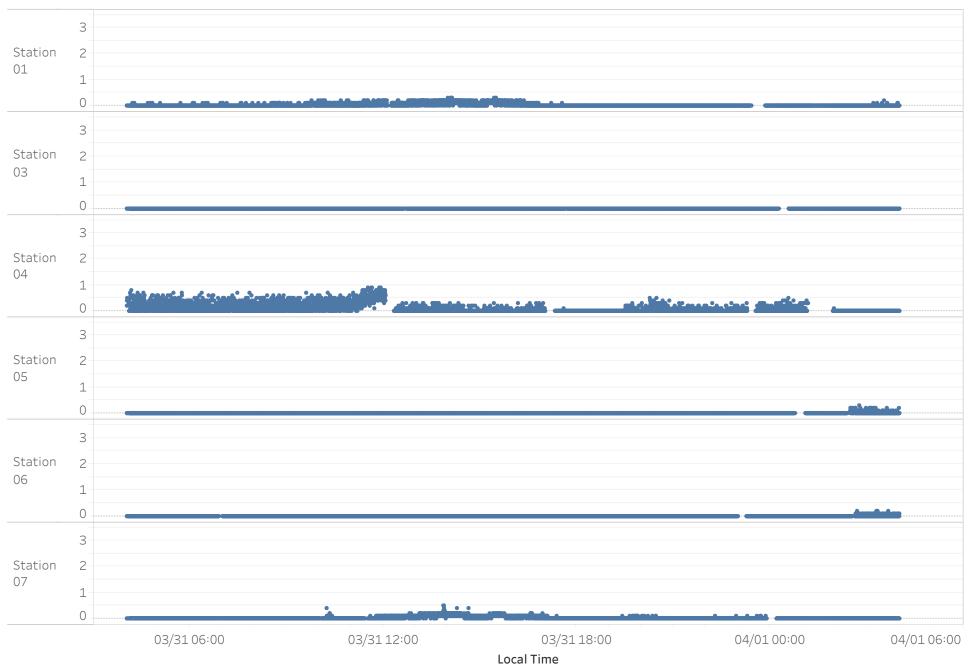

PROJ-052216 | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:02:06 AM to 4/1/2025 4:00:18 AM | **Analyte: LEL (%)**

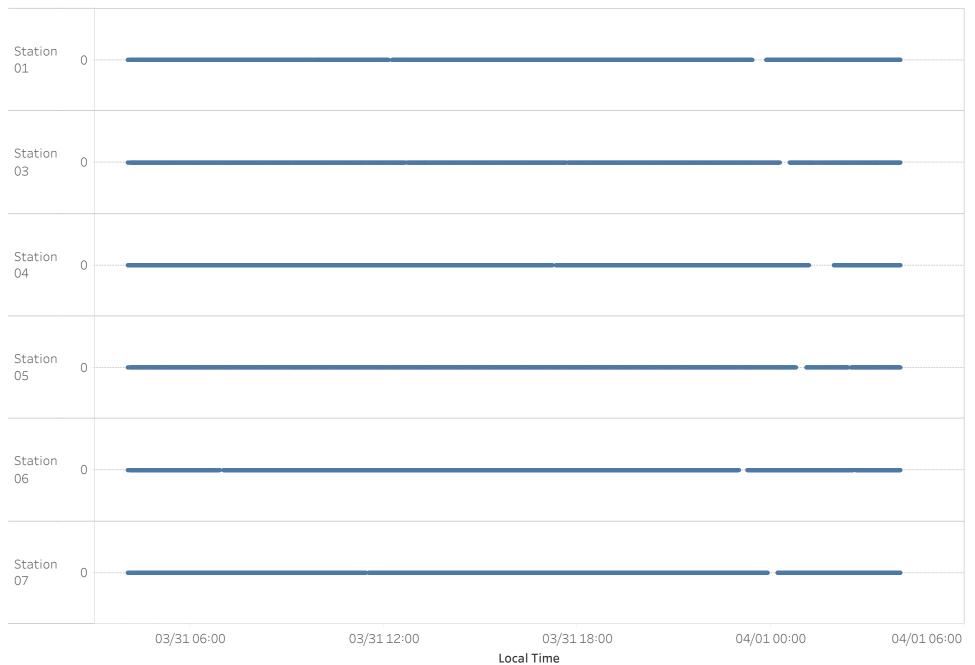


PROJ-052216 | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:02:06 AM to 4/1/2025 4:00:18 AM | **Analyte: VOCs (ppm)**

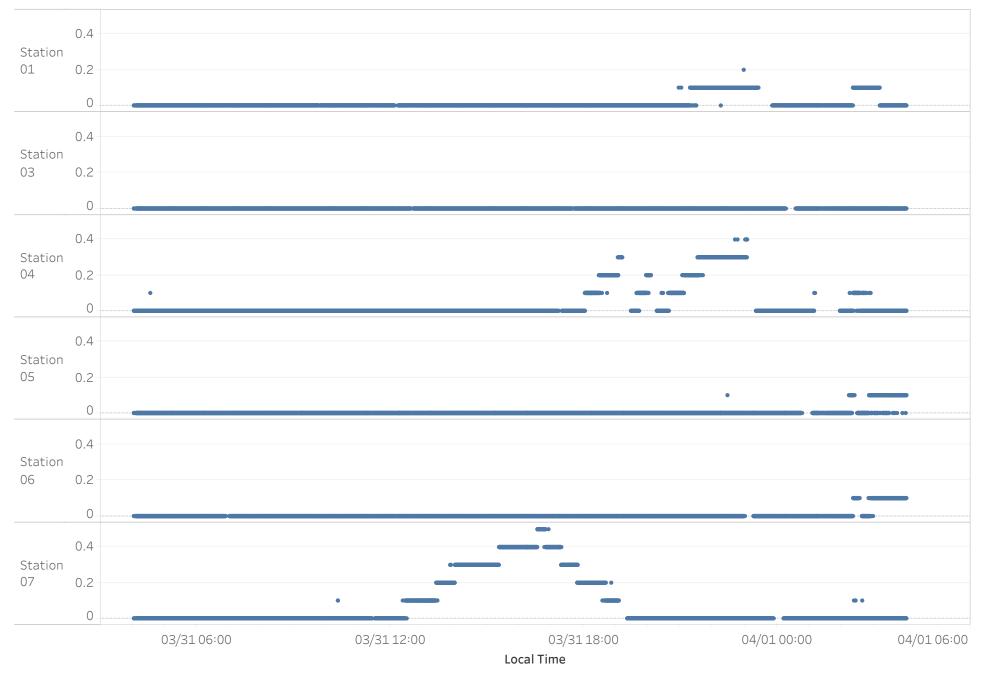

PROJ-052216 | PM2.5 Graph

SPS Technologies Fire | Abington Township, PA 03/31 05:44 to 03/31 15:33

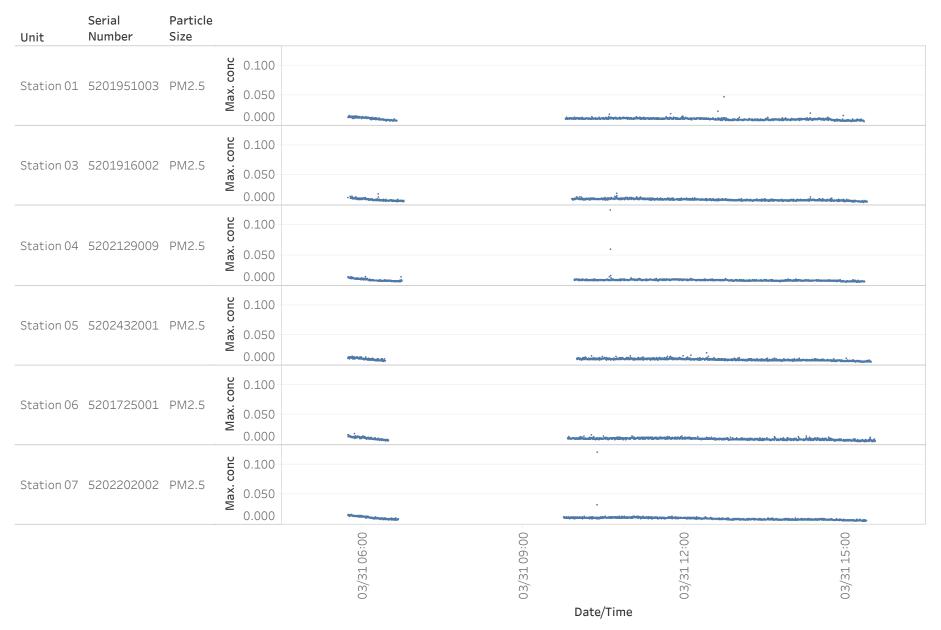

PROJ-052216 Summary Table | PM2.5


Unit	Particle Size	Count of Records	Count of Detections	Min. Concentration	Max. Concentration	Avg. Concentration
Station 01	PM2.5	1,554	1,554	0.007	0.048	0.011
Station 03	PM2.5	1,562	1,562	0.005	0.020	0.009
Station 04	PM2.5	1,540	1,540	0.006	0.124	0.009
Station 05	PM2.5	1,484	1,484	0.006	0.021	0.010
Station 06	PM2.5	1,557	1,557	0.006	0.019	0.010
Station 07	PM2.5	1,580	1,580	0.006	0.120	0.010

Attachment C


Stationary Real-Time Community Monitoring Graphs




PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:22:47 AM to 4/1/2025 5:38:54 AM | **Analyte: CO (ppm)**

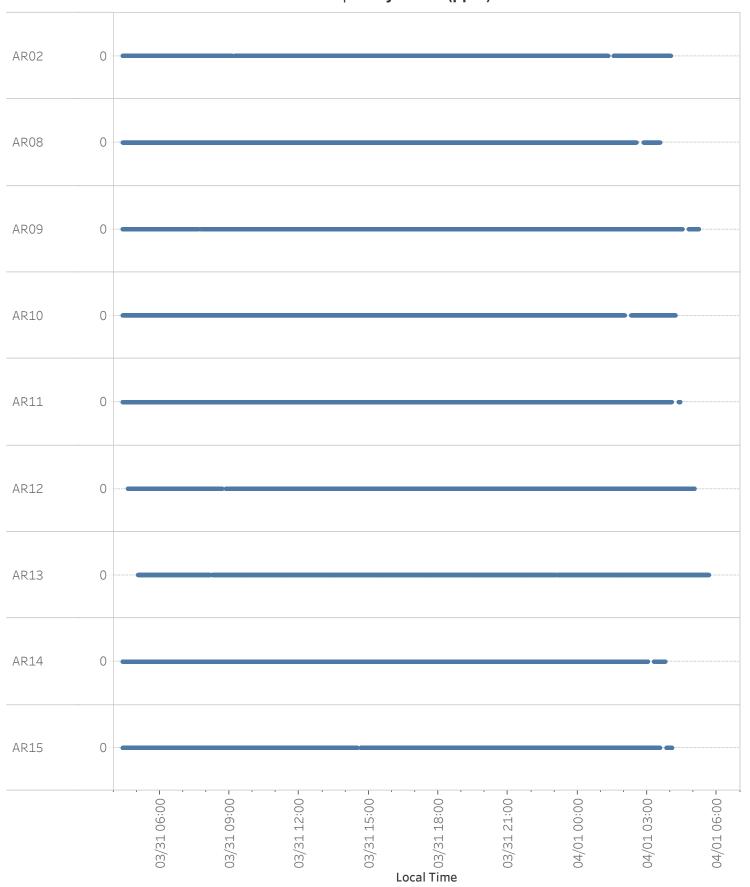


PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:22:47 AM to 4/1/2025 5:38:54 AM | **Analyte: H2S (ppm)**

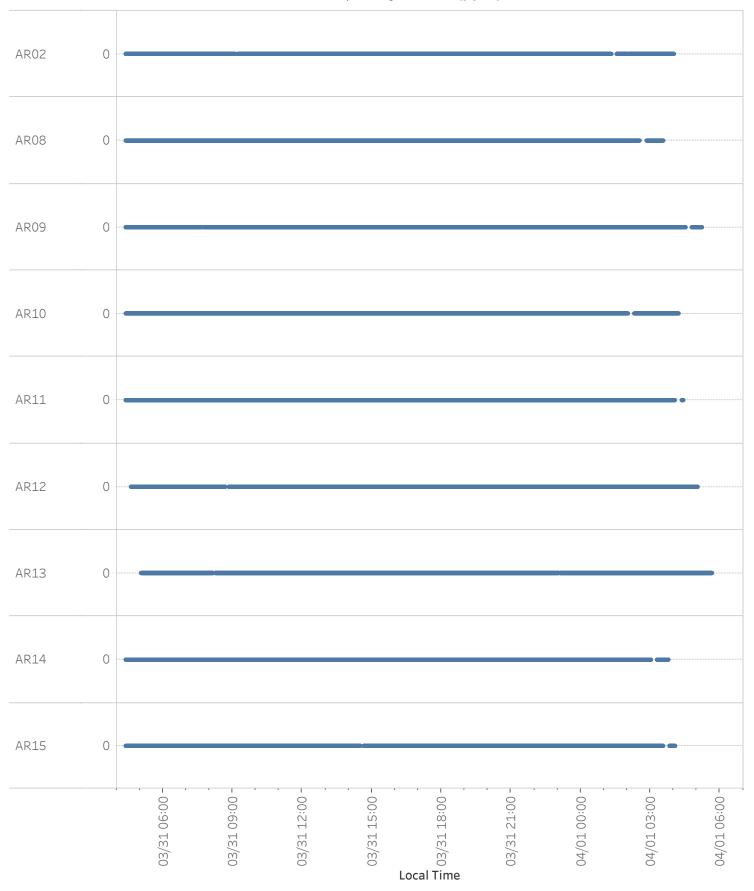


PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:22:47 AM to 4/1/2025 5:38:54 AM | **Analyte: HCN (ppm)**

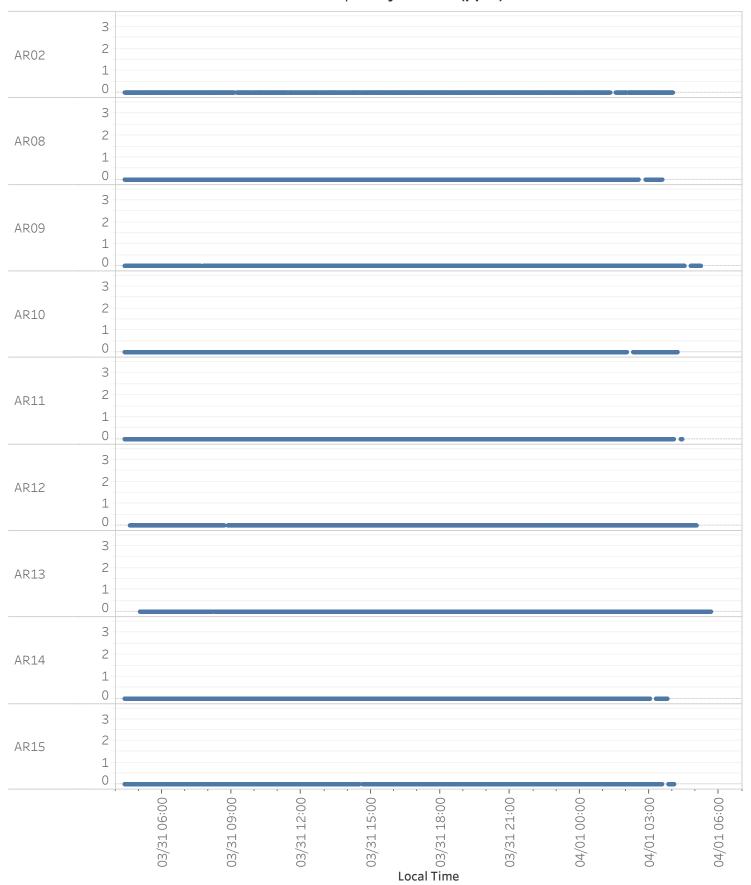

PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:22:47 AM to 4/1/2025 5:38:54 AM | **Analyte: LEL (%)**

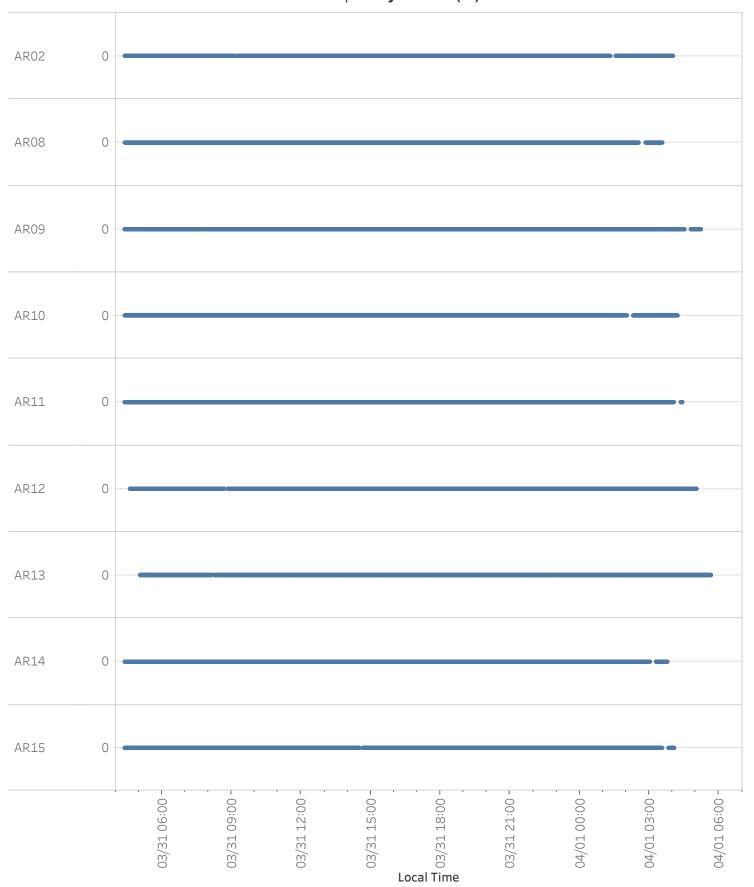


PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA 3/31/2025 4:22:47 AM to 4/1/2025 5:38:54 AM | **Analyte: VOCs (ppm)**

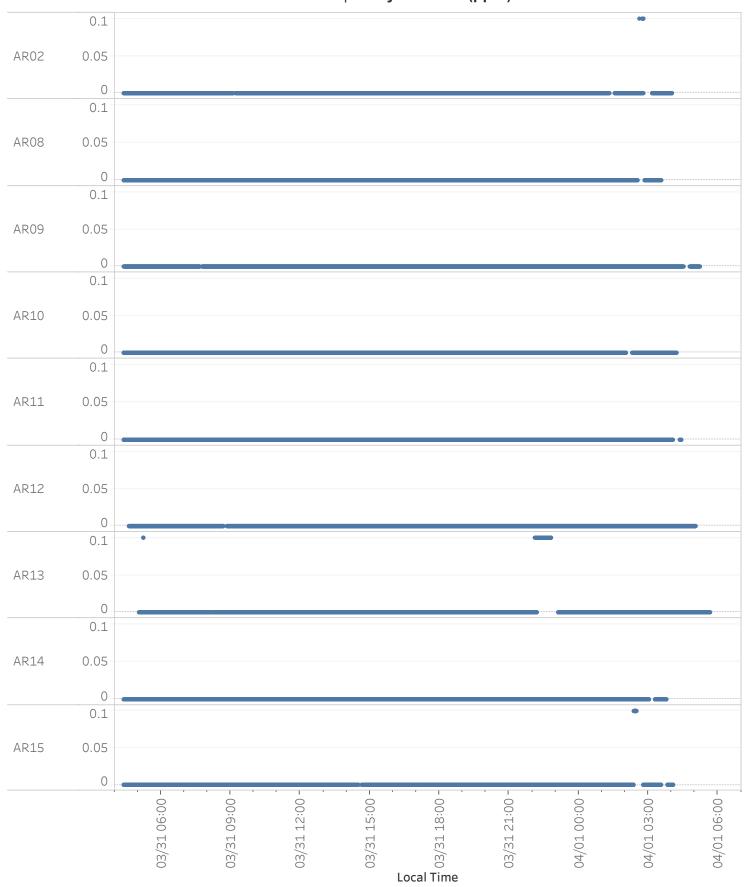

PROJ-052216 | PM2.5 Graph | Expanded Community

SPS Technologies Fire | Abington Township, PA 03/31 05:11 to 03/31 15:38

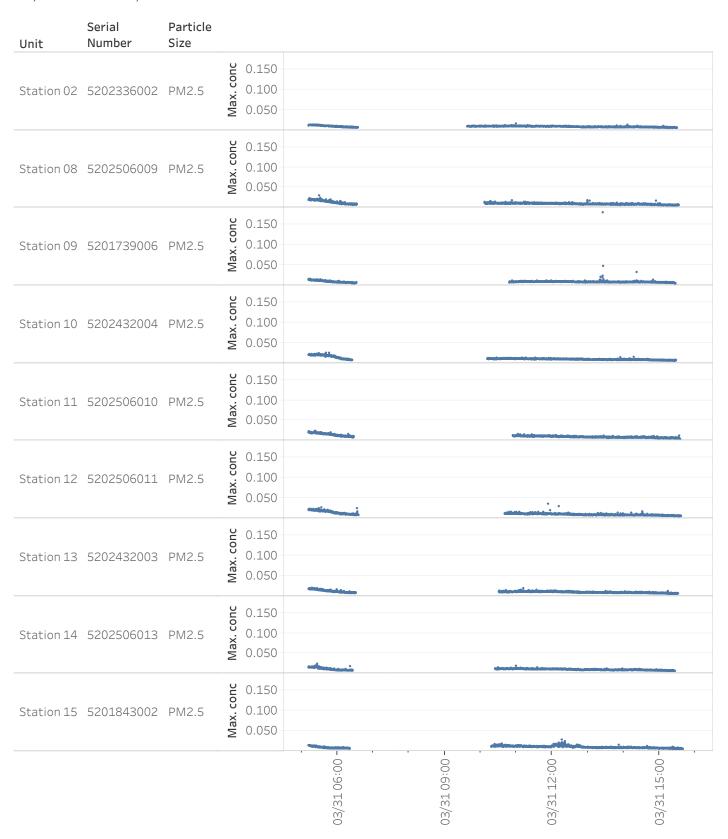

PROJ-052216 Summary Table | PM2.5 | Expanded Community


Unit	Particle Size	Count of Records	Count of Detections	Min. concentration	Max. concentration	Avg. concentration
Station 02	PM2.5	1,730	1,730	0.006	0.017	0.009
Station 08	PM2.5	1,629	1,629	0.005	0.030	0.010
Station 09	PM2.5	1,453	1,453	0.005	0.180	0.009
Station 10	PM2.5	1,561	1,561	0.006	0.026	0.011
Station 11	PM2.5	1,428	1,428	0.003	0.024	0.010
Station 12	PM2.5	1,520	1,520	0.005	0.036	0.011
Station 13	PM2.5	1,521	1,521	0.006	0.021	0.011
Station 14	PM2.5	1,505	1,505	0.006	0.024	0.010
Station 15	PM2.5	1,564	1,564	0.006	0.029	0.010

Attachment D

Meteorological Conditions



Weather Station: KESTREL (MET 3)- PA 03/31/2025 05:55 TO 04/01/2025 05:55

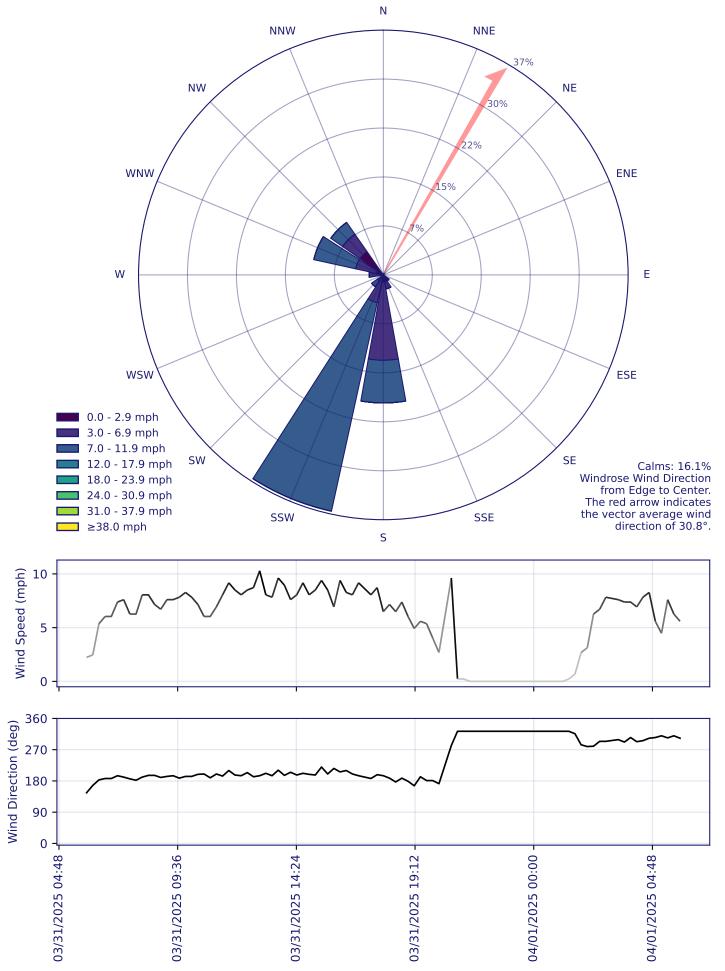

Weather Station: PHILADELPHIA NE 03/31/2025 06:54 TO 04/01/2025 05:54

